


# ELEKTRA DIVISIONE BAR SIXTIES ONE-UNIT HYDRAULIC SYSTEM

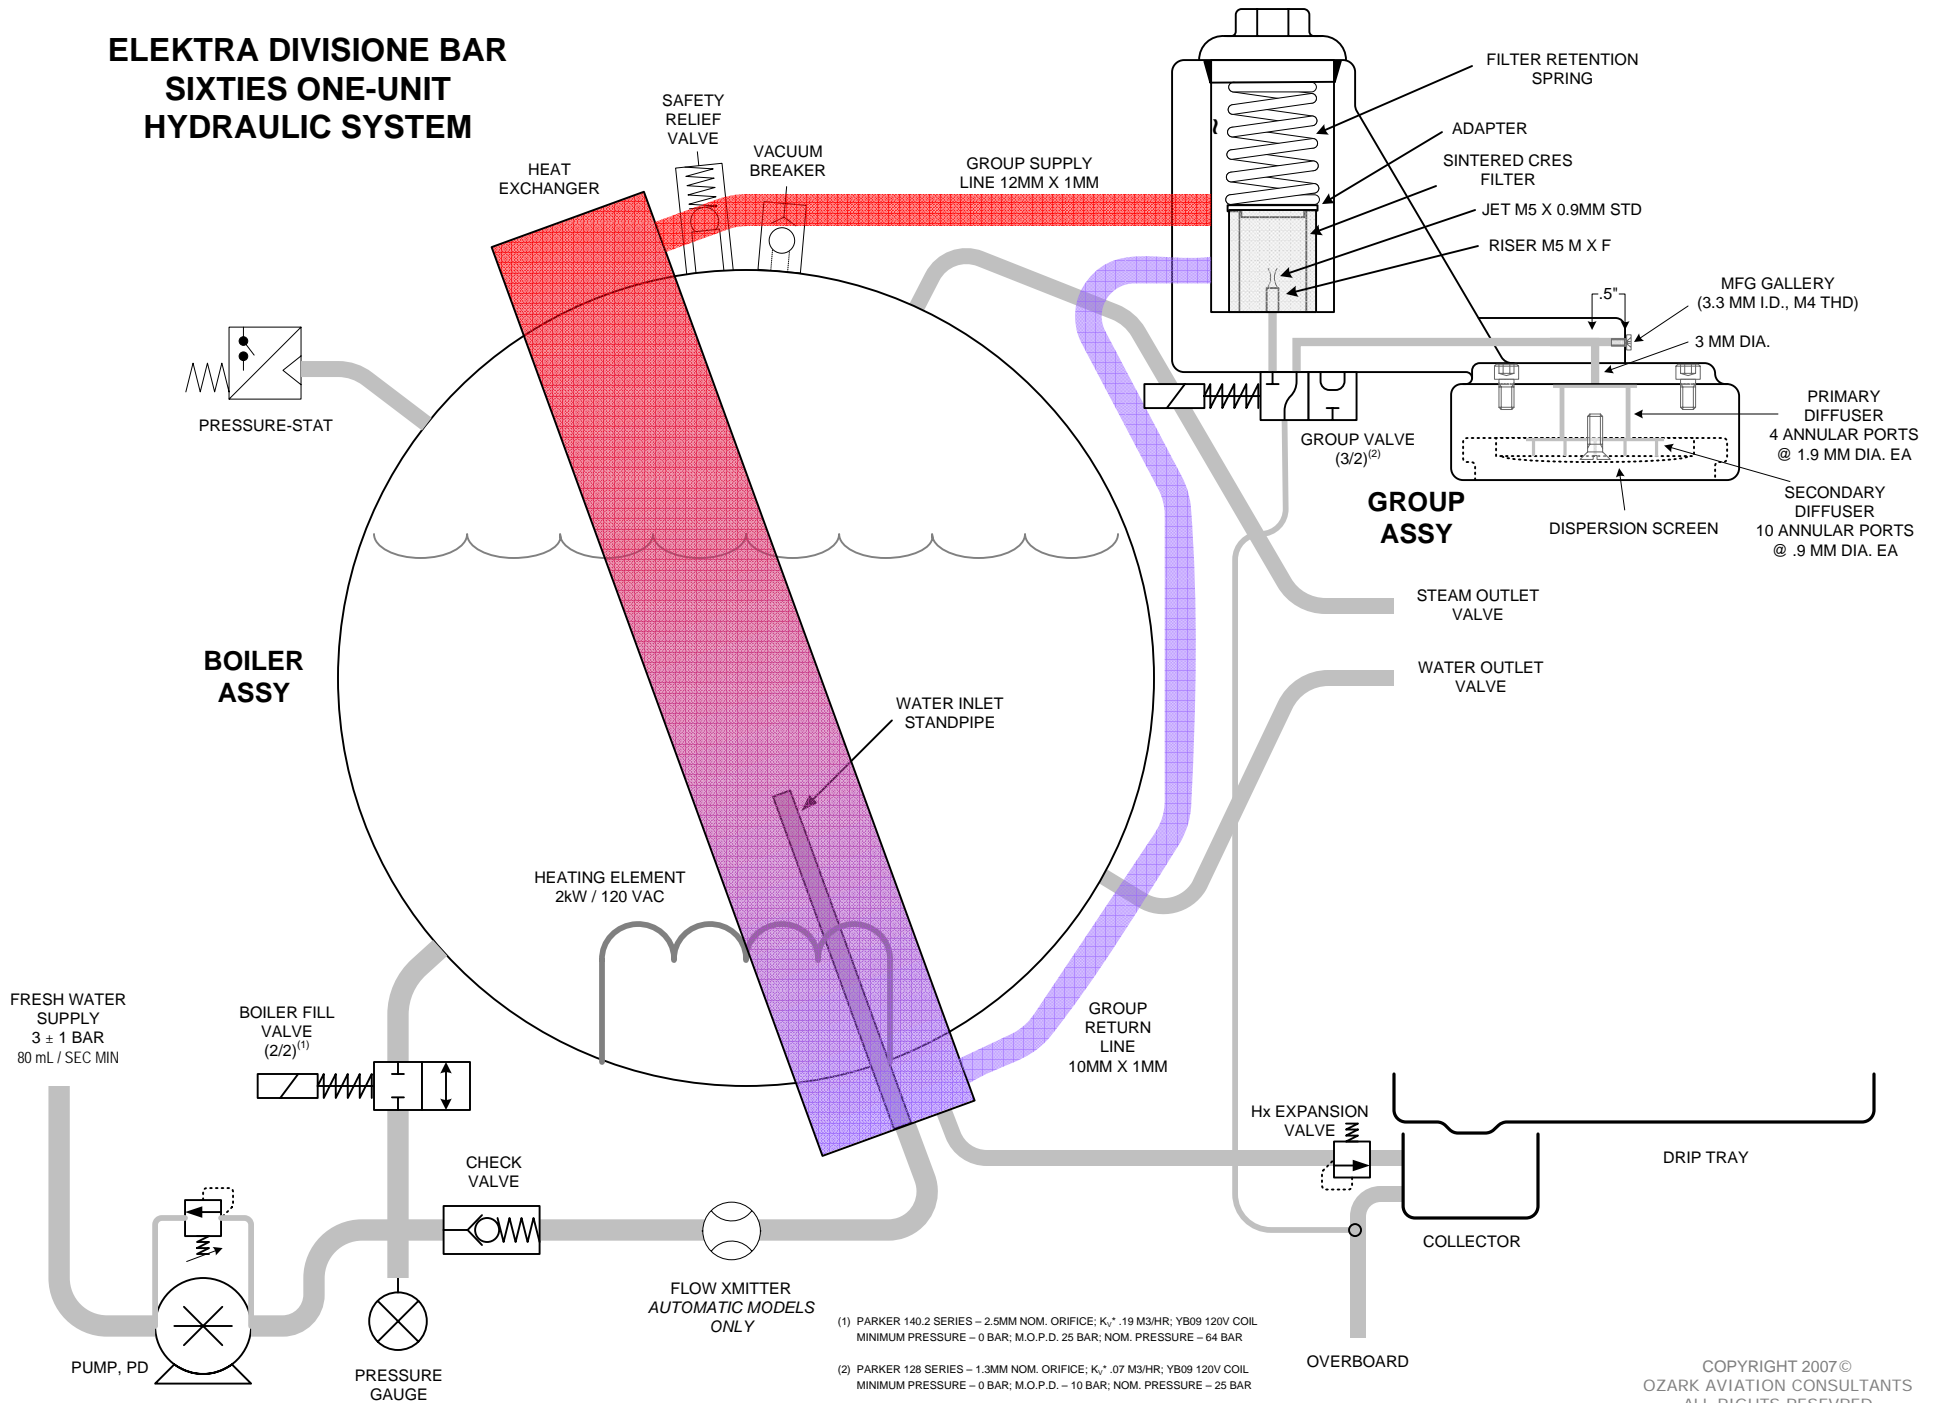

(1) PARKER 140.2 SERIES - 2.5MM NOM. ORIFICE;  $K_v$  = .19 M3/HR; YB09 120V COIL  
MINIMUM PRESSURE - 0 BAR; M.O.P.D. 25 BAR; NOM. PRESSURE - 64 BAR

(2) PARKER 128 SERIES - 1.3MM NOM. ORIFICE;  $K_v$  = .07 M3/HR; YB09 120V COIL  
MINIMUM PRESSURE - 0 BAR; M.O.P.D. - 10 BAR; NOM. PRESSURE - 25 BAR

$1K_v = 0.962 C_v$   
 $1C_v = 1.16 K_v$